RE4040-BLR



Low pressure grade RO element for brackish water

- Low-Energy Consumption
- High Permeate Flow and High Rejection







SPECIFICATIONS •

General Features

Permeate Flow Rate 2,100 GPD (7.9 m³/day)

Nominal Salt Rejection 99.6% (Minimum 99.5%)

Effective Membrane Area 85ft² (7.9 m²)

Membrane Type Thin-Film Composite


Membrane Material Polyamide (PA)

Element Configuration Spiral-Wound, FRP Wrapping

Test Conditions: 1,500 mg/L NaCl solution at 150 psig (1.03 MPa) applied pressure; 15% recovery; $77^{\circ}F(25^{\circ}C)$; pH 6.5–7.0; Permeate flow rate for each element may vary but will be no more than -5 %.

Dimensions and Weight

	Model Name	Α	В	С	D/E	Part Number	
						Inter-Connector	Brine Seal
_	RE4040-BLR	40.0 inch (1,016 mm)	3.9 inch (99.0 mm)	0.75 inch (19.1 mm)	1.05 inch (26.7 mm)	SWA01050	SWA01046

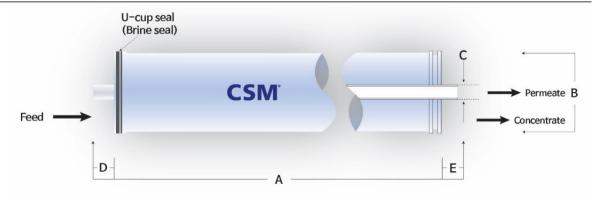

- 1. Each membrane element supplied with one interconnector (coupler) and four O-rings.
- 2. All RE4040 elements fit nominal 4.0 inch (101.6 mm) I.D. pressure vessels.

RE4040-BLR



Low pressure grade RO element for brackish water

APPLICATION DATA •

Operating Limits

operating zimes				
Max. Pressure Drop / Element	15 psi (0.10 MPa)			
Max. Pressure Drop / 240" Vessel	60 psi (0.41 MPa)			
Max. Operating Pressure	600 psi (4.14 MPa) 18 gpm (4.09 m³/hr)			
Max. Feed Flow Rate				
Min. Concentrate Flow Rate	4 gpm (0.91 m³/hr)			
Max. Operating Temperature	113°F (45°C)			
Operating pH Range	2.0 – 11.0			
CIP pH Range	1.0 – 13.0			
Max. Turbidity	1.0 NTU			
Max. SDI (15 min)	5.0			
Max. Chlorine Concentration	< 0.1 mg/L			

GENERAL HANDLING PROCEDURES•

- Elements contained in the boxes must be kept dry at room temperature (7–32°C; 40–95°F) and should not be stored in direct sunlight.
- For WET-TYPE, the preservative solution (1% sodium metabisulfite solution) is added to prohibit the growth of micro-organisms.
- Permeate from the first hour of operation should be discarded.
- Salt rejection would be stabilized within 48 hours of continuous operation depending on feedwater and operating conditions, but may take over a week for dry elements.

- Keep elements moist at all times after initial wetting.
- Avoid excessive pressure and flow spikes.
- Only use chemicals compatible with the membrane elements and components. Use of such chemicals may void the element limited warranty.
- Permeate pressure must always be equal or less than the feed/concentrate pressure. Damage caused by permeate back pressure voids the element limited warranty.
- The element shell is FRP(Fiber Reinforced Plastic). Be aware of glass fiber strands and use safety equipment.

